
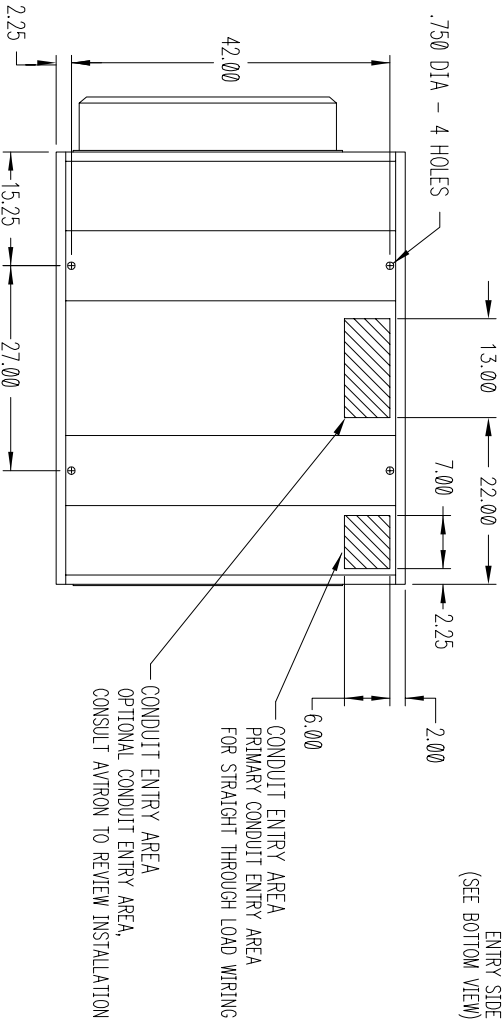


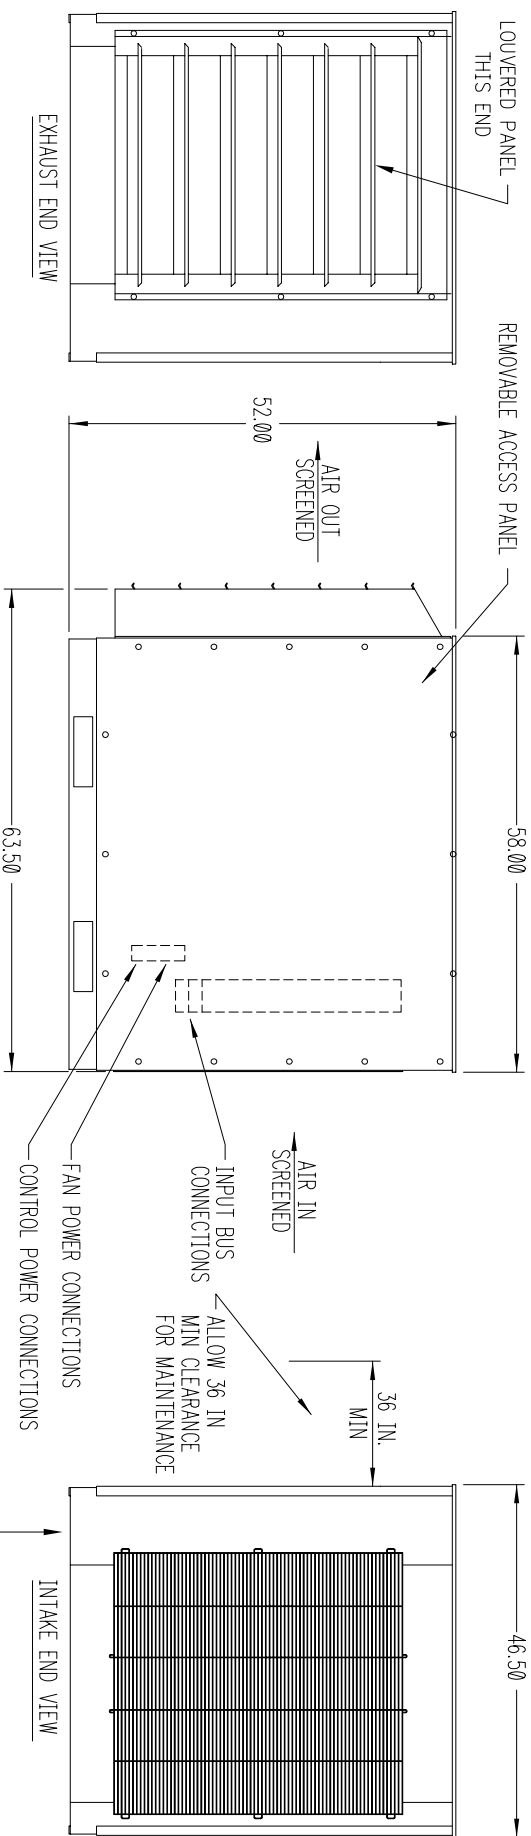

FOR APPLICATION ENGINEERING USAGE ONLY

3. AS A GENERAL GUIDE, THE MINIMUM CLEARANCE REQUIRED FROM ANY OBSTRUCTION IS:
 - 6 FEET ON INLET
 - 3 FEET ON SIDES
 - 8 FEET ON EXHAUST
- REVIEW MANUAL FOR DETAILED INSTALLATION AND SITE CONDITIONS.

2. ALL DIMENSIONS ARE APPROX.

1. WEIGHT: 1100 LBS APPROX

NOTES:

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF AYTRON MFG., INC. AND MAY NOT BE DISCLOSED TO OTHERS OR USED FOR MANUFACTURING PURPOSES WITHOUT THE WRITTEN CONSENT OF AYTRON MFG.				DRAWN J.FLAUTO DATE 3		CHECKED 0 3/25/02 SCALE		*AYTRON MANUFACTURING, INC. INDEPENDENCE, OH		DRAWING NUMBER SB3227	
CD043	A	ADDED NOTE TO "CONDUIT ENTRY AREA"	MAJ	5/3/02	EMERGENCY	APPROVED		LOAD BANK (OUTDOOR)		SHEET 1 OF 1	
NO.	REV	CHANGE	CHKD	CHKD	CHKD	EL K675A				OUTLINE DRAWING	