
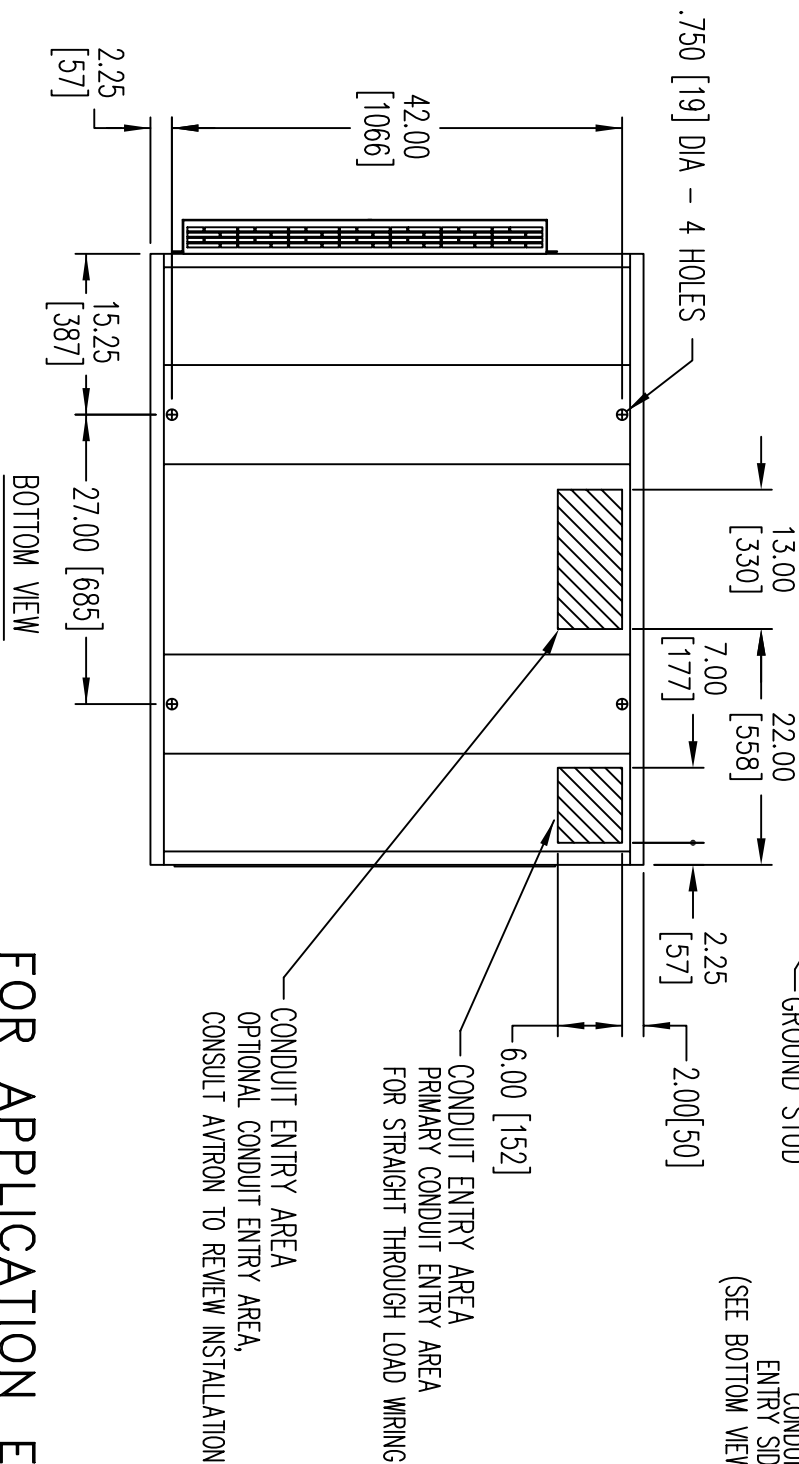


**AVTRON MODEL K675A
OUTDOOR LOAD BANK
OUTLINE DRAWING SET**

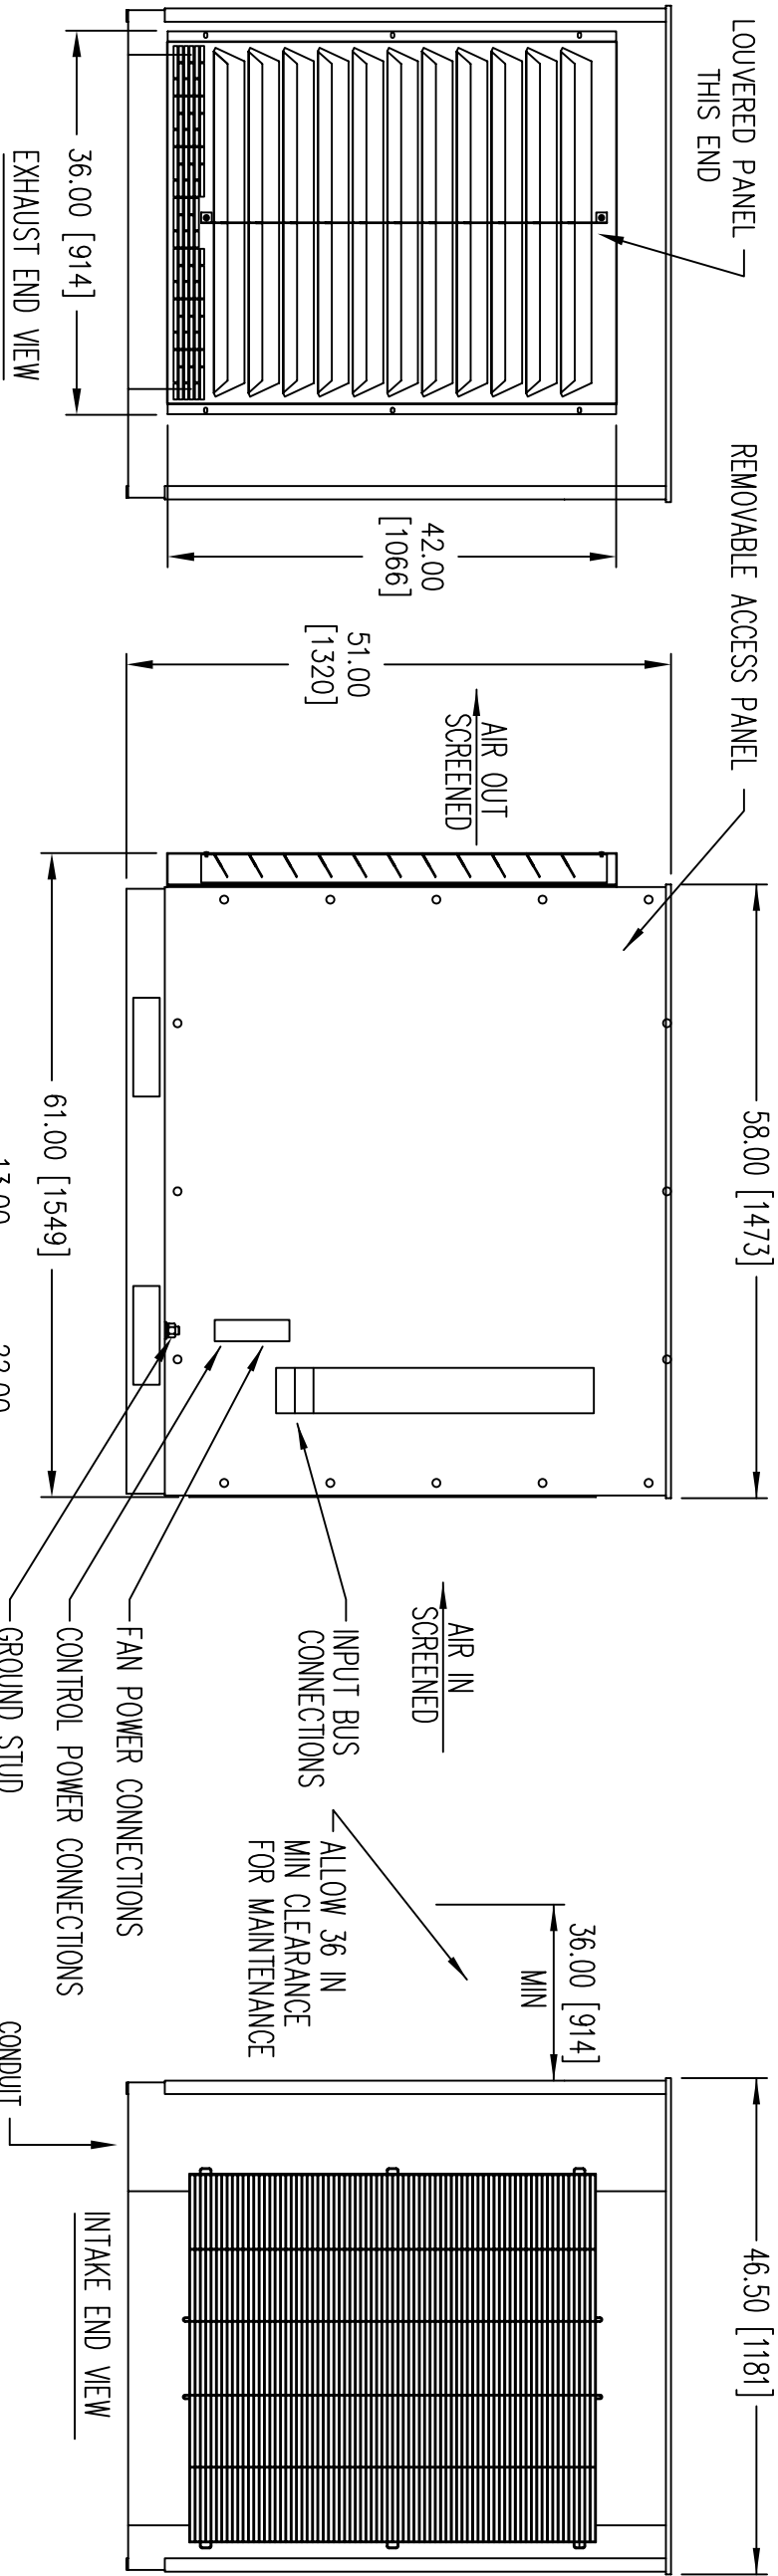

FOR APPLICATION ENGINEERING USAGE ONLY

3. AS A GENERAL GUIDE, THE MINIMUM CLEARANCE REQUIRED FROM ANY OBSTRUCTION IS:
- 6 FEET [1.83 METERS] ON INLET
 - 3 FEET [.91 METERS] ON SIDES
 - 8 FEET [2.44 METERS] ON EXHAUST
- REVIEW MANUAL FOR DETAILED INSTALLATION AND SITE CONDITIONS.
2. ALL DIMENSIONS ARE APPROX. STANDARD & [METRIC]
1. WEIGHT: 1100 LBS, [499 KG] APPROX
- NOTES:

THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION OF AVTRON MFG., INC. AND MAY NOT BE DISCLOSED TO OTHERS OR USED FOR MANUFACTURING PURPOSES WITHOUT THE WRITTEN CONSENT OF AVTRON MFG.									
CE315	D	ADDED METRIC DIMS. FACKELMANN	1/23/06	D.KOZAR	DRAWN	J.FLAUTO	DATE		
CE303	C	ADDED DIMS 36.0 & 42.0 TO EXHAUST END. ADDED GROUND STUD	J.FLAUTO 1-4-06	D.KOZAR	CHECKED	J.FLAUTO	3/25/02		
CD783	B	REV PER ECN FACKELMANN	9/1/04	J.WEMERY			SCALE		
CD043	A	ADDED NOTE TO "CONDUIT ENTRY AREA"	5/3/02	EMERY	APPROVED	J.HUDSON	1/16		
ECN NO.	REV LET.	CHANGE	CHG'D	CHK'D	MODEL	K675A			